



Accredited for compliance
 with ISO/IEC 17025.
 Accreditation Number: 2735

REPORT 16/10865.1

Replacement of ATTAR Report 16/10865

8 December 2016

**OIL-WET INCLINING PLATFORM SLIP RESISTANCE TEST
 AQUAPRO 8270 ADVANCE 2K Water Based Floor Finish.**

Prepared for: Ian McGregor
 Mirotone Pty Ltd.
 21 Marigold Street
 REVESBY NSW 2212

Specimen Description: AQUAPRO 8270 ADVANCE 2K Water Based Floor Finish.
 1x Coat AQUAPRO 8020 Clear Water Based Sealer,
 1x Coat AQUAPRO 8270 ADVANCE 2K Water Based
 Polyurethane Floor Finish containing AQUAPRO 8930 Sure Grip,
 1x Coat AQUAPRO 8270 ADVANCE 2K Water Based
 Polyurethane Floor Finish. 600x995 mm.

No. of Specimens: 1 off (Sampling conducted by client)

Surface Structure: Structured

Specimen Preparation: Washed with water and pH neutral detergent, rinsed then dried.

Specimen Configuration: Unfixed

Test Direction: Test conducted parallel with grain of timber.

Joint Type & Width: N/A

Air Temperature: 22°C

Test Standard: AS 4586: 2013 Slip resistance classification of new pedestrian
 surface materials, Appendix D – Oil-Wet Inclining Platform Test.

Test Shoe: Lupos Picasso

Test Location: ATTAR, Unit 1, 64 Bridge Road, Keysborough.

Test Date: 7 December 2016

Test Personnel: Darren Cram and Marcus Braché

| | |
|---|------------|
| Displacement Space (rounded to nearest 0.5 cm ³ /dm ²): | Not tested |
| Displacement Space Assessment Group (Appendix E, AS 4586 – 2013): | Not tested |
| Corrected mean overall acceptance angle (α_{ave}) (rounded down to the nearest degree): | 17° |
| Classification: | R10 |

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip-resistance be checked.

Reviewed By:



Douglas Lehne
 Slip Testing Technician
 Approved Signatory



Marcus Braché
 Senior Engineering Technician
 Approved Signatory

This report may not be reproduced except in its entirety.

Page 1 of 3

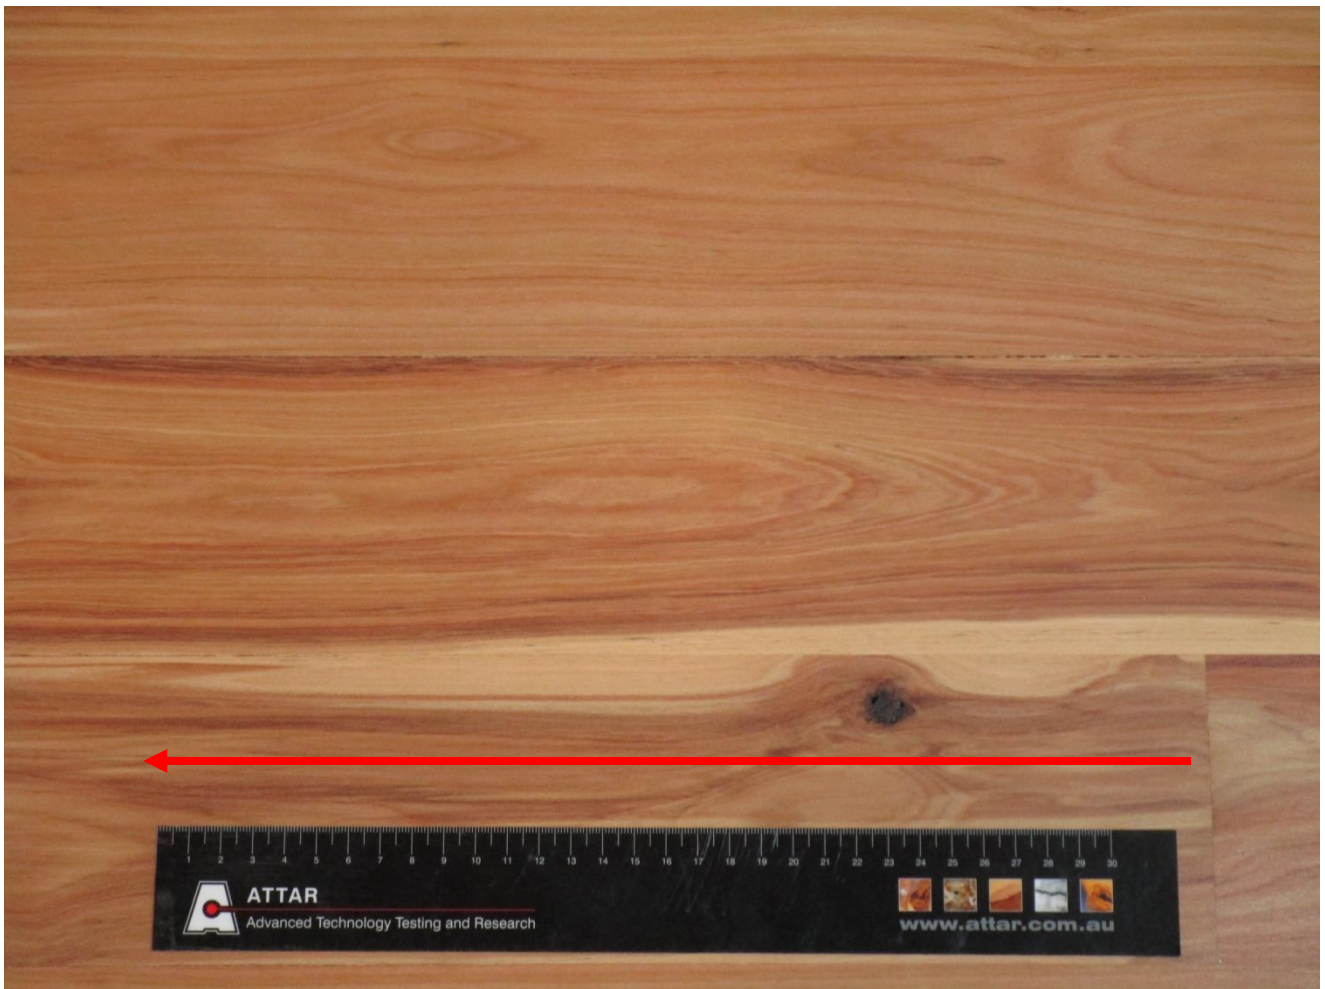


Figure 1: AQUAPRO 8270 ADVANCE 2K Water Based Floor Finish.

CLASSIFICATION CRITERIA – AS 4586 - 2013
Oil Wet Inclining Platform Test – Appendix D

Compliance

TABLE 5: CLASSIFICATION OF PEDESTRIAN SURFACE MATERIALS ACCORDING TO THE OIL-WET INCLINING PLATFORM TEST

| Classification | Angle, degrees |
|-----------------------|-----------------------|
| No Classification | <6 |
| R9 | ≥6 <10 |
| R10 | ≥10 <19 |
| R11 | ≥19 <27 |
| R12 | ≥27 <35 |
| R13 | ≥35 |